

# An Efficient Meta Heuristic Algorithm to Solve Economic Load Dispatch Problems

R.Subramanian<sup>1</sup>, A.Prakash<sup>2</sup>, K.Thanushkodi<sup>2</sup>

<sup>1</sup>Associate Professor, Akshaya College of Engineering and Technology, Coimbatore, 642 109, India

<sup>2</sup>Assistant Professor, Akshaya College of Engineering and Technology, Coimbatore, 642 109, India

<sup>3</sup>Director, Akshaya College of Engineering and Technology, Coimbatore, 642 109, India

<sup>1</sup>ssst.m1m2m3@gmail.com, <sup>2</sup>prksh830@gmail.com, <sup>3</sup>thanush12@gmail.com

<sup>1</sup>+91-9344701891, <sup>2</sup>+91-7708731622, <sup>3</sup>+91-9750911050

**Abstract:** The Economic Load Dispatch (ELD) problems in power generation systems are to reduce the fuel cost by reducing the total cost for the generation of electric power. This paper presents an efficient Modified Firefly Algorithm (MFA), for solving ELD Problem. The main objective of the problems is to minimize the total fuel cost of the generating units having quadratic cost functions subjected to limits on generator true power output and transmission losses. The MFA is a stochastic, Meta heuristic approach based on the idealized behaviour of the flashing characteristics of fireflies. This paper presents an application of MFA to ELD for six generator test case system. MFA is applied to ELD problem and compared its solution quality and computation efficiency to Genetic algorithm (GA), Differential Evolution (DE), Particle swarm optimization (PSO), Artificial Bee Colony optimization (ABC), Biogeography-Based Optimization (BBO), Bacterial Foraging optimization (BFO), Firefly Algorithm (FA) techniques. The simulation result shows that the proposed algorithm outperforms previous optimization methods.

**Keywords:** Artificial Bee Colony optimization, Biogeography-Based Optimization, Economic Load Dispatch, Firefly Algorithm, Genetic algorithm, Particle swarm optimization.

## 1 Introduction

Electrical power industry restructuring has created highly vibrant and competitive market that altered many aspects of the power industry. In this changed scenario, scarcity of energy resources, increasing power generation cost, environment concern, ever growing demand for electrical energy necessitate optimal dispatch. Economic Load Dispatch (ELD) [1], is one of the important optimization problem in power systems that have the objective of dividing the power demand among the online generators economically while satisfying various constraints. Since the cost of the power generation is exorbitant, an optimum dispatch saves a considerable amount of money. Optimal generation dispatch is one of the most important problems in power system engineering, being a technique commonly used by operators in every day system operations. Optimal generation seeks to allocate the real and reactive power throughout power system obtaining optimal operating state that reduces cost and improves overall system efficiency. The ELD problem reduces the system cost by allocating the real power among online generating units.

In the ELD problem the classical formulation presents deficiencies due to simplicity of models. Here, the power system modelled through the power balance equation and generators are modelled with smooth quadratic cost functions and generator output constraints.

To improve power system studies, new models are continuously being developed that result in a more efficient system operations. Cost functions that consider valve point loadings, fuel switching, and prohibited operating zones as well as constraints that provide more accurate representation of system such as: emission, ramp rate limits, line flow limits, spinning reserve requirement and system voltage profile. The improved models generally increase the level of complexity of the optimization problem due to the non-linearity associated with them.

Traditional algorithms like lambda iteration, base point participation factor, gradient method, and Newton method can solve the ELD problems effectively if and only if the fuel-cost curves of the generating units are piece-wise linear and monotonically increasing. The basic ELD considers the power balance constraint apart from the generating capacity limits. However, a practical ELD must take ramp rate limits, prohibited operating zones, valve point effects, and multi fuel options into consideration to provide the completeness for the ELD formulation. The resulting ELD is a non-convex optimization problem, which is a challenging one and cannot be solved by the traditional methods. Practical ELD problems have nonlinear, non-convex type objective function with intense equality and inequality constraints. Recent advances in computation and the search for better results of complex optimization problems have fomented the development of techniques known as Evolutionary Algorithms. Evolutionary Algorithms are stochastic based optimization techniques that search for the solution of problems using a simplified model of the evolutionary process. These algorithms provide an alternative for obtaining global optimal solutions, especially in the presence of non-continuous, non-convex, highly solution spaces. These algorithms are population based techniques which explore the solution space randomly by using several candidate solutions instead of the single solution estimate used by many classical techniques. The success of evolutionary algorithms lies in the capability of finding solutions with random exploration of the feasible region rather than exploring the complete region. This result in a faster optimization process with lesser computational resources while maintaining the capability of finding global optima. The conventional optimization method is not able to solve such problems due to local optimum solution convergence. Meta-heuristic optimization techniques especially Genetic Algorithms (GA) [7], Particle Swarm Optimization (PSO) [9], and Differential Evaluation (DE) [14], gained an incredible recognition as the solution algorithm for such type of ELD problems in last decade.

### ***Notations***

$a_i, b_i, c_i$  : fuel cost coefficient of  $i^{\text{th}}$  generator,  $\$/\text{MW}^2\text{h}$ ,  $\$/\text{MW h}$ ,  $\$/\text{h}$   
 $F_i (P_i)$  : fuel cost of  $i^{\text{th}}$  generator,  $\$/\text{ht}$ ; total fuel cost,  $\$/\text{h}$

$n$	: number of generators
$P_i \text{ max}$	: maximum generation limit of $i^{\text{th}}$ generator, MW
$P_i \text{ min}$	: minimum generation limit of $i^{\text{th}}$ generator, MW
$P_L$	: total system transmission loss, MW
$P_d$	: system power demand, MW
$B_{mn}$	: transmission loss coefficients, 1/MW

## 2 Problem Formulation

The classical ELD problem is an optimization problem that determines the power output of each online generator that will result in a least cost system operating state. The objective of the classical economic dispatch is to minimize the total system cost where the total system cost is a function composed by the sum of the cost functions of each generator. This power allocation is done considering system balance between generation and loads, and feasible regions of operation for each generating unit.

The objective of the classical ELD is to minimize the total fuel cost by adjusting the power output of each of the generators connected to the grid. The total fuel cost is modelled as the sum of the cost function of each generator.

The basic economic dispatch problem can be described mathematically as a minimization of problem.

$$\text{Minimize } F_t = \sum_{i=1}^n F_i(P_i) \quad (1)$$

Where  $F_i (P_i)$  is the fuel cost equation of the  $i^{\text{th}}$  plant. It is the variation of fuel cost in \$ with generated Power (MW).

$$F_i(P_i) = a_i P_i^2 + b_i P_i + c_i \quad (2)$$

The total fuel cost is to be minimized subject to the following constraints.

$$\sum_{i=1}^n P_i = P_d + P_l \quad (3)$$

$$P_l = \sum_i^n \sum_j^j P_i B_{ij} P_j \quad (4)$$

$$P_i^{min} \leq P_i \leq P_i^{max} \quad (5)$$

### 3 The Firefly Algorithm

The Firefly Algorithm (FA) [10], is a Meta heuristic, nature-inspired, optimization algorithm which is based on the social flashing behavior of fireflies, or lighting bugs, in the summer sky in the tropical temperature regions. It was developed by Dr. Xin-She Yang at Cambridge University in 2007, and it is based on the swarm behavior such as fish, insects, or bird schooling in nature. In particular, although the firefly algorithm has many similarities with other algorithms which are based on the so-called swarm intelligence, such as the famous Particle Swarm Optimization (PSO) [9], and Artificial Bee Colony optimization (ABC) [11], algorithms it is indeed much simpler both in concept and implementation. The main advantage is that it uses mainly real random numbers, and it is based on the global communication among the swarm particles [i.e., the fireflies], and as a result, it seems more effective in optimization such as the ELD problem in our case.

The FA has three particular idealized rules. They are

- All fireflies are unisex, and they will move towards more attractive and brighter ones regardless their sex.
- The degree of attractiveness of a firefly is proportional to its brightness which decreases as the distance from the other firefly increases due to the fact that the air absorbs light. If

there is not a brighter or more attractive firefly than a particular one, it will then move randomly.

- The brightness or light intensity of a firefly is determined by the value of the objective function of a given problem. For maximization problems, the light intensity is proportional to the value of the objective function.

### 3.1 Algorithm

Step 1: Read the system data such as cost coefficients, minimum and maximum power limits of all generator units, power demand and B-coefficients.

Step 2: Initialize the parameters and constants of Firefly Algorithm. They are **noff**,  $\alpha_{\max}$ ,  $\alpha_{\min}$ ,  $\beta_0$ ,  $\gamma_{\min}$ ,  $\gamma_{\max}$  and **itermax** (maximum number of iterations).

Step 3: Generate **noff** number of fireflies randomly between  $\lambda_{\min}$  and  $\lambda_{\max}$ .

Step 4: Set iteration count to 1.

Step 5: Calculate the fitness values corresponding to **noff** number of fireflies.

Step 6: Obtain the best fitness value **GbestFV** by comparing all the fitness values and also obtain the best firefly values **GbestFF** corresponding to the best fitness value **GbestFV**.

Step 7: Determine alpha ( $\alpha$ ) value of current iteration using the following equation:  $\alpha(\text{iter}) = \alpha_{\max} - ((\alpha_{\max} - \alpha_{\min}) (\text{current Iteration number}) / \text{itermax})$

Step 8: Determine the  $r_{ij}$  values of each firefly using the following equation:  $r_{ij} = \text{GbestFV} - \text{FV}$   $r_{ij}$  is obtained by finding the difference between the best fitness value **GbestFV** (**GbestFV** is the best fitness value i.e.,  $j^{\text{th}}$  firefly) and fitness value **FV** of the  $i^{\text{th}}$  firefly.

Step 9: New  $x_i$  values are calculated for all the fireflies using the following equation:

$$x_{i_{\text{new}}} = x_{i_{\text{old}}} + \beta_0 * \exp(-\gamma r_{ij}^2 * (x_j - x_i)) + \alpha(\text{iter}) * (\text{rand} - \frac{1}{2}) \quad (6)$$

In equation (6),  $\beta_0$  is the initial attractiveness  $\gamma$  is the absorption co-efficient  $r_{ij}$  is the difference between the best fitness value **GbestFV** and fitness value **FV** of the  $i^{\text{th}}$  firefly.  $\alpha(\text{iter})$  is the

randomization parameter ( In this work,  $\alpha$  (**iter**) is set to 0.2) rand is the random number between 0 and 1. In this work,  $x \rightarrow \lambda$

Step 10: Iteration count is incremented and if iteration count is not reached maximum then go to step 5

Step 11: **GbestFF** gives the optimal solution of the Economic Load Dispatch problem and the results are printed.

The basic steps of the FA can be summarized as the pseudo code for Firefly Algorithm as follows.

### 3.2 Pseudo Code

Objective function  $f(x)$ ,  $x = (x_1, \dots, x_d)^T$

Generate initial population of fireflies  $x_i$  ( $i=1, 2, \dots, n$ )

Light intensity  $I_i$  at  $x_i$  is determined by  $f(x_i)$

Define light absorption coefficient  $\gamma$

while ( $t < \text{MaxGeneration}$ )

for  $i = 1 : n$  all  $n$  fireflies

for  $j = 1 : i$  all  $n$  fireflies if ( $I_j > I_i$ ), More firefly  $i$  towards  $j$  in  $d$ -dimension; end if

Attractiveness varies with distance  $r$  via  $\exp[-\gamma r]$

Evaluate new solutions and update light intensity

end for  $j$

end for  $i$

Rank the fireflies and find the current best

end while

Post process results and visualization.

## 4 Modified Firefly Algorithm

The modified firefly algorithm MFA was proposed in this paper to improve the exploration of the searching optimum solution. Two modifications have been done. Firstly, instead of using Cartesian distance of  $r_{ij}$ , the modification was done by finding the minimum variation distance between fireflies  $i$  and secondly, to improve the exploration or diversity of the candidate of solution, the simple mutation corresponds to  $\alpha$  is adopted in the FA process. Thus it will enhance the optimum results in solving ELD. The proposed modifications can be summarized as the pseudo code given below.

### 4.1 Pseudo Code

Objective function  $f(\mathbf{x})$   $\mathbf{x} = (x_1, \dots, x_d)^T$

Generate initial population of fireflies  $x_i$  ( $i=1, 2, \dots, n$ )

Light intensity  $I_i$  at  $x_i$  is determined by  $f(x_i)$

Define light absorption coefficient  $\gamma$

while ( $t < \text{MaxGeneration}$ )

for  $i = 1: n$  all  $n$  fireflies

for  $j = 1: i$  all  $n$  fireflies

if ( $I_j > I_i$ ), More firefly  $i$  towards  $j$  in  $d$ -dimension; end if

Find the minimum variation distance of all

fireflies  $r = \min((\text{firefly } i - \text{firefly } j))$

Attractiveness varies with distance  $r$  via  $\exp[-\gamma r]$  Evaluate new solutions and update light intensity

end for  $j$

end for  $i$

randnum

Mutation if  $\text{randnum} < \text{probability of mutation}$

Rank the fireflies and find the current best



end while

Post process results and visualization.

## 5 Simulation Results

To solve the ELD problem, the MFA is coded with MATLAB programming and it was run on a computer with an Intel Core2 Duo processor, windows operating system. Mathematical calculations and comparisons can be done very quickly and effectively with MATLAB. Since the performance of the proposed algorithm sometimes depends on input parameters, they should be carefully chosen. After several runs, the following input control parameters are found to be best for optimal performance of the proposed algorithm.

In this proposed method, we represent and associate each firefly with a valid power output (i.e., potential solution) encoded as a real number for each power generator unit, while the fuel cost objective i.e., the objective function of the problem is associated and represented by the light intensity of the fireflies. In this simulation, the values of the control parameters are:  $\alpha = 0.2$ ,  $\gamma = 1.0$ ,  $\beta_0 = 1.0$  and  $n = 12$ , and the maximum generation of fireflies (iterations) is 100. The values of the fuel cost, the power limits of each generator, the power loss coefficients, and the total power load demand are supplied as inputs to the firefly algorithm. The power output of each generator, the total system power, the fuel cost with transmission losses are considered as outputs of the proposed MFA algorithm. Initially, the objective function of the given problem is formulated and it is associated with the light intensity of the swarm of the fireflies.

The MFA has been proposed for IEEE - 30 Bus with six generator test system from the references. This power system is connected through 41 transmission lines and the demand is 1263MW. The input and the cost coefficients for 3-generator and 6-generator test system are given in table 1 and table 2. In this system GA [4], [7], PSO [9], DE [14], ABC [11], BBO [6], BFO [8], FA [10], [12] and MFA [13] Algorithms were used for solving ELD. In the table 3, table 4 and table 5, the loss

coefficient matrix and the results obtained from the proposed MFA method has been compared with other methods for 3 and 6- generator systems respectively. Figure 1 and Figure 3 shows the generator output for various algorithms of 3 and 6 generator systems and Figure 2 shows the comparison chart of 6-generator system. According to the result obtained, the MFA for ELD is more advantageous than all other Algorithms. From the simulation results of six generator test system for ELD using MFA method, the total fuel cost and total line losses are decreased than all other algorithms.

**Table 1** Generating unit capacity and Fuel cost co-efficient for 3- generator unit.

Unit	$P_{i \min}$ (MW)	$P_{i \max}$ (MW)	$c_i$	$b_i$	$a_i$
1	150	600	561	7.92	0.001562
2	100	400	310	7.85	0.00194
3	50	200	78	7.97	0.00482

**Table 2** Generating unit capacity and Fuel cost co-efficient for 6- generator unit.

Unit	$P_{i \min}$ (MW)	$P_{i \max}$ (MW)	$c_i$	$b_i$	$a_i$
1	100	500	240	7.0	0.0070
2	50	200	200	10.0	0.0095
3	80	300	220	8.5	0.0090
4	50	150	200	11.0	0.0090
5	50	200	220	10.5	0.0080
6	50	120	190	12.0	0.0075

**Table 3** Loss Co-Efficient Matrix

$$B_{mn} = \begin{pmatrix} 0.0017 & 0.0012 & 0.0007 & -0.0001 & -0.0005 & -0.0002 \\ 0.0012 & 0.0014 & 0.0009 & 0.0001 & -0.0006 & -0.0001 \\ 0.0007 & 0.0009 & 0.0031 & 0.0000 & -0.0010 & -0.0006 \\ -0.0001 & 0.0001 & 0.0000 & 0.0024 & -0.0006 & -0.0008 \\ -0.0005 & -0.0006 & -0.0010 & -0.0006 & 0.0129 & -0.0002 \\ -0.0002 & -0.0001 & -0.0006 & -0.0008 & -0.0002 & 0.0150 \end{pmatrix}$$

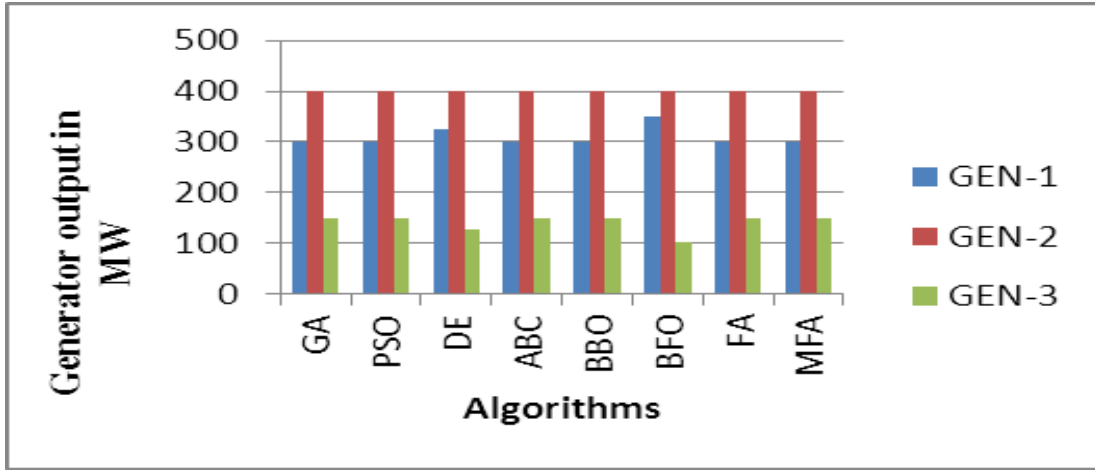


Figure 1 Output graph of 3 generator system for Various Algorithms

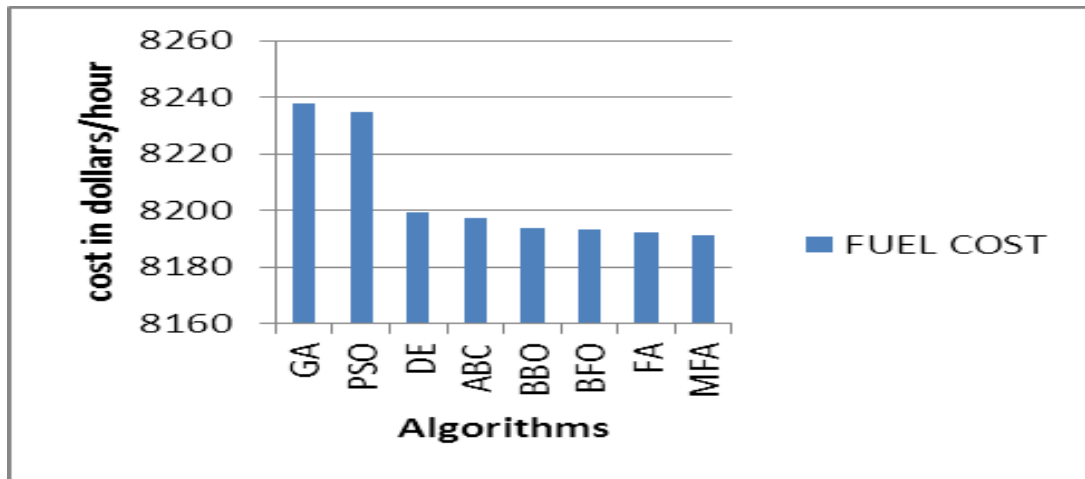


Figure 2 Fuel cost graph of 3 generator system for various Algorithms

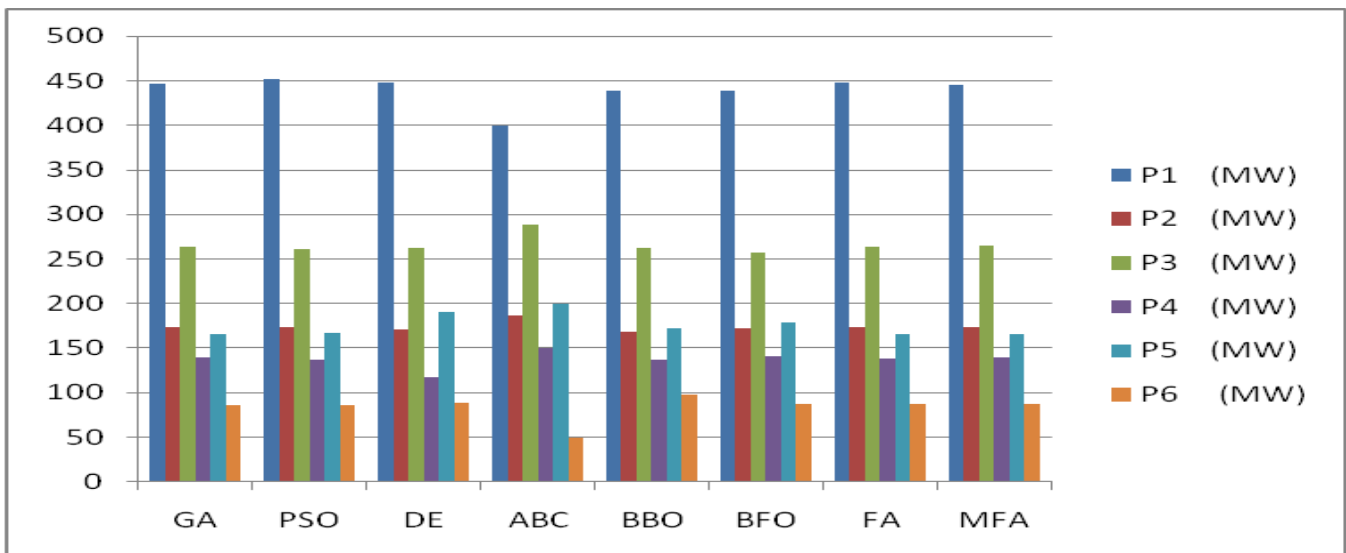


Figure 3 Comparison Chart Showing Total Power Output, Power Loss, Fuel Cost and Total Line Losses of 6-generator system for various Algorithms

**Table 4** Comparison Table Showing Simulation Result Of 3-generator unit for GA, PSO, DE, ABC, BBO, BFO, FA and MFA Algorithms

Sl.No	Description	GA	PSO	DE	ABC	BBO	BFO	FA	MFA
1.	P <sub>1</sub> (MW)	300.00	300.27	324.40	300.25	300.28	349.46	300.00	300.00
2.	P <sub>2</sub> (MW)	400.00	400.00	399.19	399.98	399.99	399.19	400.00	400.00
3.	P <sub>3</sub> (MW)	150.00	149.73	126.41	149.77	149.73	101.35	150.00	150.00
4.	Power Output (MW)	850.00	850.00	850.00	850.00	850.00	850.00	850.00	850.00
5.	Fuel cost (\$/h)	8237.60	8234.72	8199.29	8197.39	8194.07	8193.44	8192.32	8191.13

**Table 5** Comparison Table Showing Simulation Result of 6-generator unit for GA, PSO, DE, ABC, BBO, BFO, FA and MFA Algorithms

Sl.no	Description	GA	PSO	DE	ABC	BBO	BFO	FA	MFA
1.	P <sub>1</sub> (MW)	447.08	451.97	447.50	400.00	438.65	438.21	445.08	<b>447.39</b>
2.	P <sub>2</sub> (MW)	173.18	173.16	170.52	186.55	167.90	172.58	173.08	<b>173.24</b>
3.	P <sub>3</sub> (MW)	263.92	261.16	261.90	289.00	262.82	257.42	264.42	<b>263.32</b>
4.	P <sub>4</sub> (MW)	139.06	136.85	116.91	150.00	136.77	141.09	139.59	<b>138.00</b>
5.	P <sub>5</sub> (MW)	165.58	166.70	190.41	200.00	171.76	179.37	166.02	<b>165.41</b>
6.	P <sub>6</sub> (MW)	86.63	85.68	88.49	50.00	97.67	86.88	87.21	<b>87.80</b>
7.	Power Output (MW)	1275.47	1275.52	1275.73	1275.55	1275.57	1275.73	1275.40	<b>1275.50</b>
8.	P <sub>loss</sub> (MW)	12.47	12.52	12.73	12.55	12.52	12.55	12.40	<b>12.50</b>
9.	Fuel cost (\$/h)	15466.00	15458.00	15456.56	15452.00	15445.90	15446.00	15443.00	<b>15442.90</b>
10.	Execution time(sec.)	62.02	58.18	54.09	6.20	2.82	4.23	8.52	<b>11.02</b>

## 6 Conclusion

The proposed MFA to solve ELD problem by considering the practical constraints has been presented in this paper. From the comparison table it is observed that the proposed algorithm exhibits a better performance with respect to all other techniques. The effectiveness of MFA was demonstrated and tested in this research. From the simulations, it can be seen that MFA gave the best result of total cost minimization compared to all other optimization methods. In future, the proposed MFA can be used to solve ELD considering the valve point loading effects.

## References

- [1] Wood, A. J. and Wollenberg, B. F., *Power Generation, Operation, and Control*, 1996, Wiley, New York, 2nd ed.
- [2] A. Bakirtzis, P. N. Biskas, C. E. Zoumas, and V. Petridis, *Optimal Power Flow By Enhanced Genetic Algorithm*, *IEEE Transactions on Power Systems*, Vol.17, No.2, pp.229-236, May 2002.
- [3] D. C. Walters and G. B. Sheble, *Genetic Algorithm Solution of Economic Dispatch with Valve Point Loading*, *IEEE Transactions on Power Systems*, Vol. 8, No.3, pp.1325–1332, Aug. 1993.
- [4] P. H. Chen and H.C. Chang, *Large-Scale Economic Dispatch by Genetic Algorithm*, *IEEE Transactions on Power Systems*, Vol. 10, No.4, pp. 1919–1926, Nov. 1995.
- [5] A. H. Mantawy, Y. L. Abdel-Magid and S. Z. Selim, *Integrating Genetic Algorithm, Tabu search, and Simulated Annealing for the Unit Commitment Problem*, *IEEE Transactions on Power Systems*, Vol. 14, pp. 829-836, August 1999.
- [6] D. Simon, “Biogeography-based optimization,” *IEEE Trans. Evol. Comput.*, vol. 12, no. 6, pp.702–713, Dec. 2008
- [7] G. B. Sheble and K. Brittig, *Refined genetic algorithm- economic dispatch example*, *IEEE Trans. Power Systems*, Vol.10, pp.117-124, Feb.1995.
- [8] B. K. Panigrahi, V. R. Pandi. “Bacterial foraging optimization: Nelder-Mead hybrid algorithm for economic load dispatch.” *IET Gener. Transm, Distrib.* Vol. 2, No. 4. Pp.556-565, 2008.
- [9] K. S. Kumar, V. Tamilselvan, N. Murali, R. Rajaram, N. S. Sundaram, and T. Jayabarathi, “Economic load dispatch with emission constraints using various PSO algorithms,” *WSEAS Transactions on Power Systems*, vol. 3, no. 9, pp. 598–607, 2008.
- [10] X. S. Yang, “Firefly algorithm, Levy flights and global optimization,” in *Research and Development in Intelligent Systems XXVI*, pp. 209–218, Springer, London, UK, 2010

- [11] Dervis Karaboga and Bahriye Basturk, 'Artificial Bee Colony (ABC) Optimization Algorithm for Solving Constrained Optimization Problems,' Springer-Verlag, IFSA 2007, LNAI 4529, pp. 789–798.
- [12] X.-S. Yang, S. S. Sadat Hosseini, and A. H. Gandomi, "Firefly Algorithm for solving non-convex economic dispatch problems with valve loading effect," *Applied Soft Computing*, vol. 12, pp. 1180-1186, 2012.
- [13] X. S. Yang, "Firefly algorithms for multimodal optimization," in Proceedings of the Stochastic Algorithms: Foundations and Applications (SAGA '09), vol. 5792 of Lecture Notes in Computing Sciences, pp. 178–178, Springer, Sapporo, Japan, October 2009.
- [14] R. Storn and K. Price, Differential Evolution—A Simple and Efficient Adaptive Scheme for Global Optimization Over Continuous Spaces, International Computer Science Institute,, Berkeley, CA, 1995, Tech. Rep. TR-95–012.
- [15] Nayak, S.K.; Krishnanand, K.R.; Panigrahi, B.K.; Rout, P.K. -Application of Artificial Bee Colony to economic load dispatch problem with ramp rate limit and prohibited operating zones, IEEE world congress on Nature and Biologically inspired computing (NaBIC)-2009, pp-1237 – 1242 .
- [16] A. Bakirtzis, V. Petridis, and S. Kazarlis, Genetic Algorithm Solution to the Economic Dispatch Problem, Proceedings. Inst. Elect. Eng. –Generation, Transmission Distribution, Vol. 141, No. 4, pp. 377–382, July 1994.
- [17] C. A. Roa-Sepulveda and B. J. Pavez-Lazo, A solution to the optimal power flow using simulated annealing, IEEE Porto Power Tech Conference, 10-13 th September, Porto, Portugal.
- [18] E. Zitzler, M. Laumanns, and S. Bleuler, "A Tutorial on Evolutionary Multi-objective Optimization," Swiss Federal Institute of Technology \_ETH\_ Zurich, Computer Engineering and Networks Laboratory \_TIK\_, Zurich, Switzerland.
- [19] G. Zwe-Lee, "Particle swarm optimization to solving the economic dispatch considering the generator constraints," *IEEE Transactions on Power Systems*, vol. 18, pp. 1187-1195, 2003.

- [20] J. Sun, W. Fang, D. Wang, and W. Xu, "Solving the economic dispatch problem with a modified quantum-behaved particle swarm optimization method," *Energy Conversion and Management*, vol. 50, pp. 2967-2975, 2009.
- [21] K. T. Chaturvedi, M. Pandit, and L. Srivastava, "Self-Organizing Hierarchical Particle Swarm Optimization for Nonconvex Economic Dispatch," *IEEE Transactions on Power Systems*, vol. 23, pp. 1079-1087, 2008.
- [22] C-C Kuo, "A novel string structure for economic dispatch problems with practical constraints," *Energy Conversion and Management*, vol. 49 (2008) pp. 3571-3577.
- [23] T. Niknam, H. D. Mojarrad, H. Z. Meymand, and B. B. Firouzi, "A new honey bee mating optimization algorithm for non-smooth economic dispatch," *Energy*, vol. 36, pp. 896-908, 2011.
- [24] T. Yalcinoz, H. Altun, and M. Uzam, "Economic dispatch solution using a genetic algorithm based on arithmetic crossover," in *Power Tech Proceedings, 2001 IEEE Porto*, 2001, p. 4 pp. vol.2.
- [25] S. Affijulla and S. Chauhan, "A new intelligence solution for power system economic load dispatch," in *10th International Conference on Environment and Electrical Engineering (EEEIC)*, 2011, pp.1-5.



**R. Subramanian** received the B.E degree in Electrical and Electronics Engineering from Coimbatore Institute of Technology in the year 2005 and M.E degree in Power Systems Engineering from Government College of Technology, Coimbatore in the year 2007. He is currently doing PhD in the area of Power system control and operation under Anna University. Presently he is working as an Associate professor in the Department of Electrical and Electronics Engineering at Akshaya College of Engineering and Technology, Coimbatore. His research interests are power system analysis, power system control and operation, mathematical computations, optimization and Soft Computing Techniques.



**A. Prakash** received the B.E degree in Electrical and Electronics Engineering from Sri Nandhanam College of Engineering and Technology in the year 2005 and M.Tech degree in Power Electronics and Drives from PRIST University, Tanjore in the year 2011. He is currently working as an Assistant Professor in the Department of Electrical and Electronics Engineering at Akshaya College of Engineering and Technology, Coimbatore. His research interests are Power System Modeling and Analysis and Power Electronic applications to Power Systems.



**K. Thanushkodi** received his B.E. degree in Electrical and Electronics Engineering from College of Engineering, Guindy in the year 1972. He has received M.Sc. (Engg.) degree from PSG College of Technology, Coimbatore in the year 1974. He has received PhD degree in Power Electronics from Bharathiyar University in the year 1991. Presently he is the Director of Akshaya College of Engineering and Technology, Coimbatore and he is a former Syndicate Member, Anna University of Technology, Coimbatore. His research interests are Power Electronics Drives, Electrical Machines, Power Systems, and Soft Computing techniques, Computer Networks, Image Processing and Virtual Instrumentation.