

# Back-flashover Investigation of HV Transmission Lines Using Transient Modeling of the Grounding Systems

F. Amanifard\* and N. Ramezani\*\*

**Abstract:** The article presents the transients analysis of the substation grounding systems and transmission line tower footing resistances which can affect to the back-flashover (BF) or overvoltage across insulator chain in an HV power systems by using EMTP-RV software. The related transient modeling of the grounding systems is based on a transmission line (TL) model with considering the soil ionization. In addition, different configuration of grounding system have been simulated to calculated the BF, including number of vertical grounding rod, length of rod, point of lightning current injection into the grounding grid and using two depth design of grounding system where the surface of substation under consideration is very small or it is necessary to bury the grounding grid in the rocky media, occasionally. The simulation results have shown that how the mentioned parameters can considerably affect inception of BF, and suitable design of grounding system can reduce damages caused by lightning.

**Keywords:** Back-flashover (BF), Grounding system, Transient modeling

## 1 Introduction

Transmission lines are most important, vulnerable and sensitive components of the power system which may be encountered with the environment phenomena such as the lightning strokes. The lightning overvoltage may be caused line insulation breakdown, due to occurrence of the BF phenomenon [1-2]. When lightning strikes a tower or a ground wire, a traveling voltage is generated which travels back and forth along the tower, being reflected at the tower grounding system. Consequently, the transient ground potential rise (TGPR) have been created at the line tower and the cross-arms. This transient over voltages cause stresses across the insulator chains. Whenever this transient voltage exceeds the withstand voltage level, flashover will occur. Such flashover is named BF as the voltage at the tip of cross arm becomes larger than the voltage of line conductor. Therefore, the BF voltages are generally generated by multiple reflections along the tower under stroke. The maximum magnitude of transient induced

voltage caused by lightning will be directly proportional to the peak of lightning stroke current [3].

In general, the BF forecast is a very complicated task due to it depends nonlinearly on different parameters such as the positions of phase conductors and guard wires of transmission line, line towers and tower footing grounding systems, soil ionization, insulator chains and etc. It is necessary to mention that to predict the back-flashover, exactly, all of components at the HV power system must be properly modeled in transient regime. In [4-6] the authors have already described and validated a simplified resistive model, able to simulate the ground potential rise (GPR) of typical tower grounding systems. [7, 8] have simulated the grounding system as a Pi-circuit model in non-linear conditions. In [9], the Pi-circuit grounding system model is implemented in an ATP-EMTP 150 kV–50 Hz model for BF simulation.

In this paper, the transient model of subsystems in HV power system have been proposed and investigated in the EMTP-RV software in order to propose an accurate prediction of BF. Grounding systems of substations and towers, as the most important components of the power system, have been modeled by lossy transmission lines method (TLM) considering soil ionization under lightning impulse. According to the simulation results, considering different states such as grounding system arrangement, point of impulse injection and etc. have contributions on the inception of BF, time plots of the insulator chain voltage and transient ground potential rise. Results show that the proposed procedures can be

Iranian Journal of Electrical & Electronic Engineering, 2016.

Paper received 12 March 2016 and accepted 2 October 2016.

\* F. Amanifard is MSc Student at University of Science and Technology of Mazandaran, Behshahr, Iran.

E-mail: [faezhamanifard@gmail.com](mailto:faezhamanifard@gmail.com)

\*\* N. Ramezani is with Electric and Computer Engineering Dept. of University of Science and Technology of Mazandaran, Behshahr, Iran.

E-mails: [ramezani@mazust.ac.ir](mailto:ramezani@mazust.ac.ir)

Corresponding Author: N. Ramezani.

used to accurately predict the maximum transient voltage at the cross-arms of the towers which results in a BF across an insulator chain.

## 2 Transient Modeling of Power System Components

In this section, modeling of different components for a power system is proposed in transient regime caused by lightning strokes.

### 2.1 Modeling of Lightning, Transmission Line and Tower

A 1000 kV double circuit transmission line have been considered to study the transient behavior of a power system against the lightning strokes. The span length of related transmission line is 500 m. Phase conductors and guard wires of transmission line were simulated by means of “Jmarti” frequency-dependent model in EMTP\_RV.

The tower configuration and its impedance model have been shown in Fig.1. Modeling of transmission line tower is based on multistory model where consists of main legs and cross-arms [10-11]. Also the impedance values of tower model have been given in Table 1.

Lightning current is modeled by the proposed model of CIGRE as an impulse current source with waveform 100 kA/3μsas shown in Fig. 2.

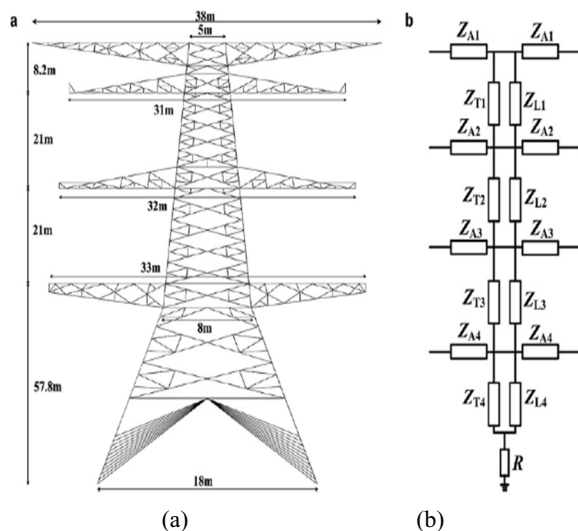


Fig. 1.(a) The tower under consideration and (b) its impedance model.

Table 1 Impedance value of the tower model [4].

| K | Z <sub>Ak</sub> (Ω) | Z <sub>Tk</sub> (Ω) | Z <sub>Lk</sub> (Ω) |
|---|---------------------|---------------------|---------------------|
| 1 | 307                 | 142                 | 1287                |
| 2 | 313                 | 135                 | 1215                |
| 3 | 298                 | 117                 | 1053                |
| 4 | 280                 | 80                  | 720                 |

### 2.2 Grounding System Model

Tower footing grounding system has been assumed as a resistance, 10 ohm, to investigate the transmission line and tower behavior against lightning stroke, frequently. Though this procedure is useful to assess voltage and current waveforms along the transmission lines, but it cannot be used for accurate calculation of transientsignals due to neglecting the capacitive, inductive and conductive characteristics of grounding systems. Moreover, using the grounding system with different configuration for towers create a variety impedance value which must be considered by the related models. Many high frequency models have been presented for the grounding system of tower footing systems. Equivalent resistance of the vertical and horizontal electrode can be calculated by Eq. (1) and Eq. (2), respectively [12].

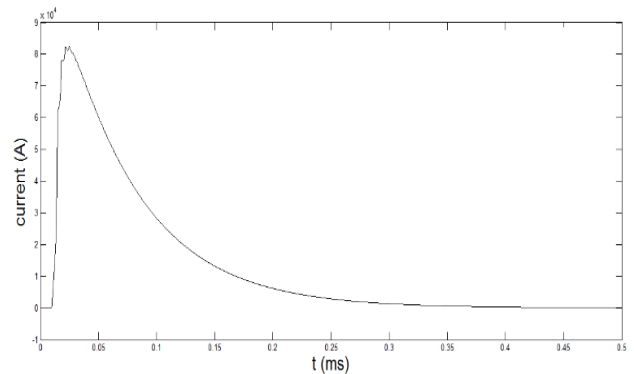


Fig. 2 Typical waveform of lightning current.

$$R = \frac{\rho_s}{2 \cdot \pi \cdot l} \left[ \ln\left(\frac{4 \cdot l}{a}\right) - 1 \right] \quad (1)$$

and

$$R = \frac{\rho_s}{\pi \cdot l} \left[ \ln\left(\frac{2 \cdot l}{\sqrt{2 \cdot a \cdot h}}\right) - 1 \right] \quad (2)$$

where h, l, a and ρ<sub>s</sub> are buried depth (for the horizontal electrode), length, radius of electrode (m) and the soil resistivity (Ω.m), respectively.

One of the most accurate methods to simulate the grounding system in transient regime is TLM (transmission line method). This method is a numerical technique, which can be used to both in the time and in the frequency domains [13].

In high frequency analysis under lightning stroke, the soil ionization is an important phenomenon that must be considered in the modeling of grounding systems. This phenomenon can be represented by a set of cylindrical zones around the electrode as shown in Fig. 3a.

According to [13], in Fig. 3b, time-variable resistive and conductive components for the grounding electrode must be considered in order to contain the soil

ionization effects. Therefore, Eq. (3) to Eq.(5) can be used to calculate time-variable resistive component for both horizontal and vertical electrodes which can simulate the soil ionization and skin effects. It is necessary to mention that the skin effect has been considered by using coefficient  $\delta = \sqrt{\frac{2 \cdot \rho_c}{\omega \cdot \mu}}$  in Eq. (5) where  $f = 500 \text{ KHz}$ .

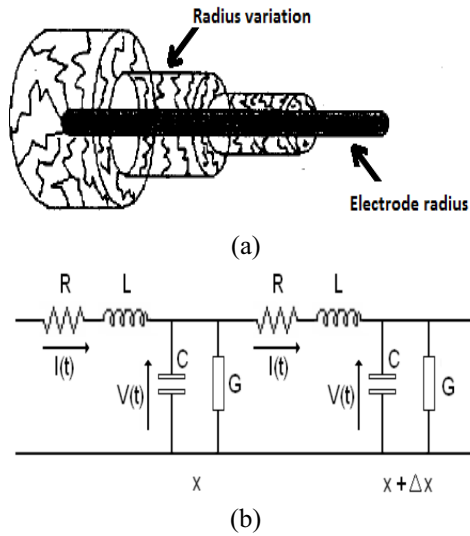


Fig. 3.(a) Representation of the soil ionization around an electrode, (b) Modeling of grounding electrode [13]

$$R(t) = R_T \cdot \frac{1}{\sqrt{1 + \frac{I(t)}{I_g}}} \quad (3)$$

where  $I(t)$  is the lightning current passing through grounding electrode and  $I_g$  is the critical current which makes the soil ionization as shown in Eq.(4). Also  $E_{cr}$  is the critical electric field and has been considered as 300 kV/m.

$$I_g = \frac{E_{cr} \cdot \rho_s}{2 \cdot \pi \cdot R_T^2} \quad (A)(4)$$

and

$$R_T = \frac{\rho_c \cdot \Delta x}{2 \cdot \pi \cdot a \cdot \delta} \quad (5)$$

Eq. (6) and Eq. (7) are used to compute the conductive component of the vertical and horizontal electrode, respectively [13]. In addition  $\Delta x$  is the length of segment of an electrode in m.

$$G(t) = \frac{2 \cdot \pi \cdot \Delta x}{\rho_s \cdot \ln\left(\frac{2 \cdot l}{a}\right)} \cdot \sqrt{1 + \frac{I(t)}{I_g}} \quad (6)$$

$$G(t) = \frac{2 \cdot \pi \cdot \Delta x}{\rho_s \cdot \left[\ln\left(\frac{2 \cdot l}{\sqrt{2 \cdot h \cdot a}}\right) - 1\right]} \cdot \sqrt{1 + \frac{I(t)}{I_g}} \quad (7)$$

where  $\epsilon_r$  is the air permittivity (F/m) and  $\rho_c$  is the conductor resistivity ( $\Omega \cdot m$ ). Also the capacitive and inductive components of the vertical grounding electrode have been calculated by the following equations.

$$C = \frac{2 \cdot \pi \cdot \epsilon_0 \cdot \epsilon_r \cdot \Delta x}{\ln\left(\frac{2 \cdot l}{a}\right)} \quad (F) \quad (8)$$

and

$$L = \frac{\mu_0 \cdot \Delta x}{2 \cdot \pi} \cdot \ln\left(\frac{2 \cdot l}{a}\right) \quad (H) \quad (9)$$

In addition, Eq. (10) and Eq. (11) can be used to obtain the parameters of the horizontal electrode.

$$C = \frac{2 \cdot \pi \cdot \epsilon_0 \cdot \epsilon_r \cdot \Delta x}{\ln\left(\frac{2 \cdot l}{\sqrt{2 \cdot h \cdot a}}\right) - 1} \quad (F) \quad (10)$$

and

$$(H)L = \frac{\mu_0 \cdot \Delta x}{2 \cdot \pi} \cdot \left[\ln\left(\frac{2 \cdot l}{\sqrt{2 \cdot h \cdot a}}\right) - 1\right] \quad (11)$$

### 2.3 Modeling of the power system under study by EMTP\_RV

BF simulations have been carried out by considering a long overhead transmission line as mentioned in section A. In this study, it has been assumed that lightning stroke hits to the first tower. Fig. 4 shows the simulated power system with considering a horizontal/vertical grounding electrode by EMTP\_RV.

As shown in Fig. 5, transient voltages on tower corresponding to the cross-arms of g1 and g2 have the highest values caused by lightning stroke. The voltage across the insulator chain is found by subtraction of voltage of tower and phase voltage at any instant. It is necessary to mention that the maximum transient voltages across the insulator chain will be produced by "maximum voltage at tower+ maximum phase voltage" in the worst condition.

### 3 Comparison and Validation

The obtained results of the simulation in EMTP\_RV and Ref. [4] have been compared and validated to the depicted resulted in Fig. 6. In this study, lightning current passing through the different transmission line towers such as tower under direct lightning stroke and adjacent towers have been measured and compared to Ref. [4] as shown in Table 2.

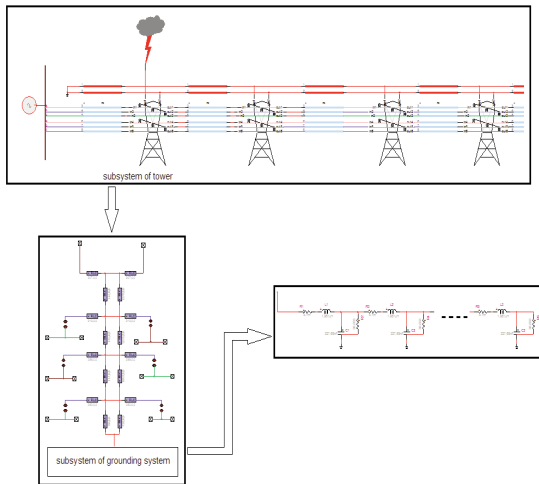


Fig. 4 Simulated power system under consideration.




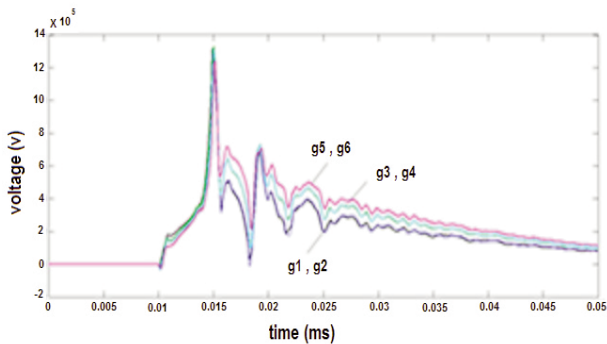


Fig. 5 Induced over voltages on tower at different points

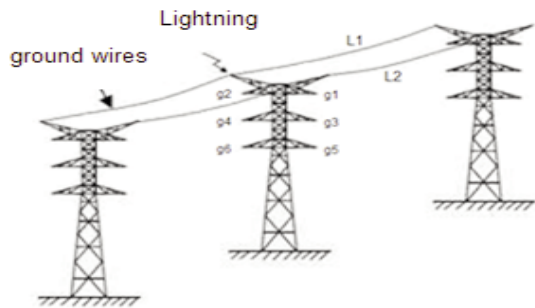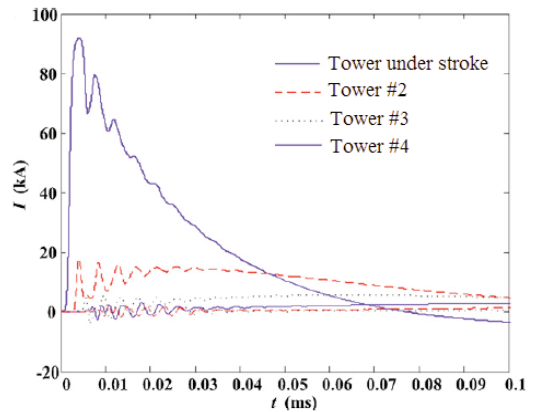

(a)

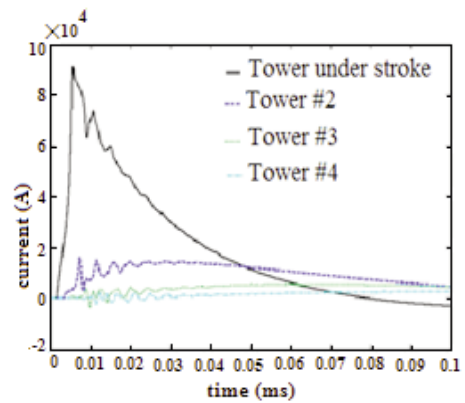

(b)

Fig. 6 Lightning current waveform on towers. (a) Ref. [4] and (b) Simulation results

## 4 Simulation Results and Discussions

### 4.1 Calculated over voltage across g2 with different segmentation

In order to compute the maximum over voltage across the insulator chains, grounding system modeling has been carried out by TLM. In this model, at first grounding conductor must be divided to several segments. Then each of segments has been substituted by a presented model in section 2. In this study, grounding conductor radius and buried depth are 0.0125m and 0.5m, respectively; and  $\rho_c = 1.7241 \times 10^{-8} \Omega m$ ,  $\epsilon_r = 10$  and  $\rho_s = 100 \Omega m$ .

Fig. 7 shows the effect of the number of segments on the calculated over voltage across the insulator chains for a vertical and horizontal grounding electrode with the length of 20 m. Obviously, the related over voltage can be accurately calculated with proper choice of the segment length ( $\Delta x$ ).

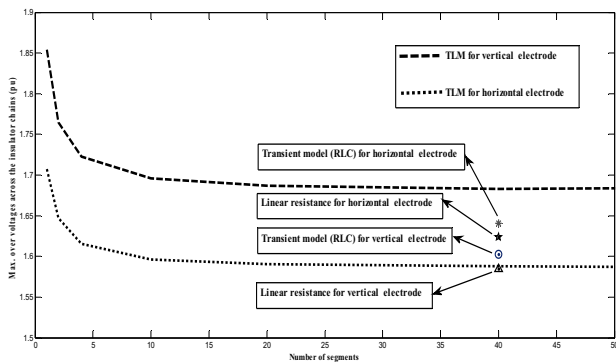


Fig. 7 Calculated over voltage across g2 with respect to the number of segments

According to the obtained results, the induced over voltage across the insulator chains with considering a linear resistance for a horizontal and vertical grounding electrode with the length of 20 m have -%2.28 and %5.8 errors, respectively, with respect to using TLM for

grounding electrodes. Implementing high-frequency lumped RLC circuit models (as introduced in [12]) for horizontal or vertical grounding electrodes also have -%3.36 and %4.77 errors, respectively. The errors are significant, thus, TLM model is the best one for overvoltage studies. According to the presented results in Fig. 7, where the results converge, optimum segmentation can be found for accurate calculation of the maximum induced over voltages.

#### 4.2 Effect of Soil ionization phenomenon on BF

Effect of considering soil ionization phenomenon in the proposed model for calculating maximum over voltage across the insulator chains has been presented in Table 3; both for vertical and horizontal grounding electrodes with different segment lengths and with the same data in the previous section.

Table 2 Comparison between obtained lightning current passing through towers in kA by [4] and simulation

| Tower footing resistance | Comparison between | Tower under strike | Tower #2   | Tower #3   | Tower #4    | Tower #5    | Tower #6    |
|--------------------------|--------------------|--------------------|------------|------------|-------------|-------------|-------------|
| 10 $\Omega$              | Ref. [4]           | 91.8               | 17.8       | 5.5        | 2.9         | 1.9         | 1.3         |
|                          | Simulation results | 91.1               | 16.3       | 5.5        | 2.6         | 1.7         | 1.1         |
| <b>Error (%)</b>         |                    | <b>0.6</b>         | <b>8.4</b> | <b>0</b>   | <b>10.3</b> | <b>10.5</b> | <b>15.3</b> |
| 20 $\Omega$              | Ref. [4]           | 84.7               | 17.9       | 7.3        | 3.8         | 2.2         | 1.4         |
|                          | Simulation results | 83.2               | 17.3       | 7.2        | 3.8         | 2.2         | 1.3         |
| <b>Error (%)</b>         |                    | <b>1.7</b>         | <b>3.3</b> | <b>1.3</b> | <b>0</b>    | <b>0</b>    | <b>7.1</b>  |
| 30 $\Omega$              | Ref. [4]           | 78.6               | 18.9       | 8.2        | 4.5         | 2.8         | 1.8         |
|                          | Simulation results | 76.5               | 18.2       | 8.1        | 4.5         | 2.8         | 1.8         |
| <b>Error (%)</b>         |                    | <b>2.6</b>         | <b>3.2</b> | <b>1.2</b> | <b>0</b>    | <b>0</b>    | <b>0</b>    |
| 40 $\Omega$              | Ref. [4]           | 73.4               | 19.1       | 8.8        | 5           | 3.2         | 2.1         |
|                          | Simulation results | 70.9               | 18.7       | 8.6        | 4.9         | 3.1         | 2.1         |
| <b>Error (%)</b>         |                    | <b>3.4</b>         | <b>2</b>   | <b>2.2</b> | <b>2</b>    | <b>3.1</b>  | <b>0</b>    |
| 60 $\Omega$              | Ref. [4]           | 64.7               | 19.5       | 9.5        | 5.6         | 3.7         | 2.5         |
|                          | Simulation results | 61.8               | 18.9       | 9.3        | 5.5         | 3.6         | 2.6         |
| <b>Error (%)</b>         |                    | <b>4.4</b>         | <b>3</b>   | <b>2.1</b> | <b>1.7</b>  | <b>2.7</b>  | <b>0</b>    |

As expected, the soil ionization has a significant influence on the produced potential across the insulation chain. The results presented in Table 3 conclude that ignoring soil ionization, especially where soil resistivity increases for example in rocky soils, will result in highly oversized plans for tower footing grounding systems.

#### 4.3 Grounding system under study with different configuration

In order to compare and discuss about the influence of the configuration of the grounding system on BF under fast transients as a lightning stroke, grounding systems with vertical rods have been considered and simulated as shown in Fig. 8. This grounding system has formed by the mesh of 6m $\times$ 6m which are buried in

the soil at 0.5m depth and has been modeled by using TLM.

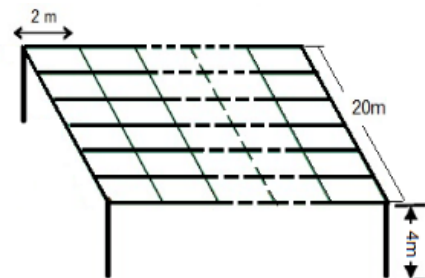


Fig. 8 Grounding system under study

In sequel, the effect of different parameters on maximum over voltage across insulator chains have been investigated and discussed.

#### 4.3.1 The effects of number and length of the vertical rods

Number of vertical rods as well as their length has no significant effect on the maximum over voltage as shown in Tables 4 and 5.

**Table 3.** Effect of soil ionization on the maximum over voltage across the insulation chain

|                            |                             | Segment length [m]           | 20           | 10           | 5            | 2            | 1            | 0.5          | 0.25         |
|----------------------------|-----------------------------|------------------------------|--------------|--------------|--------------|--------------|--------------|--------------|--------------|
| $\rho_s$<br>( $\Omega.m$ ) | Type of grounding electrode |                              |              |              |              |              |              |              |              |
| 100                        | Vertical                    | Without soil ionization [pu] | 1.854203     | 1.765273     | 1.723024     | 1.695611     | 1.686635     | 1.683066     | 1.684941     |
|                            |                             | With soil ionization [pu]    | 1.722965     | 1.595354     | 1.525714     | 1.474365     | 1.453043     | 1.440979     | 1.434067     |
|                            |                             | <b>Difference (%)</b>        | <b>-7.1</b>  | <b>-9.6</b>  | <b>-11.5</b> | <b>-13</b>   | <b>-13.8</b> | <b>-14.4</b> | <b>-14.9</b> |
|                            | Horizontal                  | Without soil ionization [pu] | 1.707678     | 1.647053     | 1.615954     | 1.596201     | 1.590187     | 1.587657     | 1.586242     |
|                            |                             | With soil ionization [pu]    | 1.623021     | 1.541322     | 1.493656     | 1.458008     | 1.443708     | 1.435612     | 1.431081     |
|                            |                             | <b>Difference (%)</b>        | <b>-4.9</b>  | <b>-6.4</b>  | <b>-7.6</b>  | <b>-8.6</b>  | <b>-9.2</b>  | <b>-9.5</b>  | <b>-9.8</b>  |
| 1000                       | Vertical                    | Without soil ionization [pu] | 2.6444517    | 2.602096     | 2.582384     | 2.569786     | 2.566592     | 2.565202     | 2.562766     |
|                            |                             | With soil ionization [pu]    | 1.739742     | 1.611203     | 1.540566     | 1.487363     | 1.464408     | 1.450586     | 1.442082     |
|                            |                             | <b>Difference (%)</b>        | <b>-34.2</b> | <b>-38.1</b> | <b>-40.3</b> | <b>-42.1</b> | <b>-42.9</b> | <b>-43.5</b> | <b>-43.7</b> |
|                            | Horizontal                  | Without soil ionization [pu] | 2.311695     | 2.271605     | 2.257443     | 2.244842     | 2.239658     | 2.241310     | 2.239627     |
|                            |                             | With soil ionization [pu]    | 1.640134     | 1.556608     | 1.507553     | 1.469839     | 1.453805     | 1.444055     | 1.438029     |
|                            |                             | <b>Difference (%)</b>        | <b>-29.1</b> | <b>-31.5</b> | <b>-33.2</b> | <b>-34.5</b> | <b>-35.1</b> | <b>-35.6</b> | <b>-35.8</b> |
| 2000                       | Vertical                    | Without soil ionization [pu] | 3.240917     | 3.130288     | 3.109214     | 3.074433     | 3.081416     | 3.116214     | 3.082942     |
|                            |                             | With soil ionization [pu]    | 1.749846     | 1.620384     | 1.548779     | 1.494175     | 1.470149     | 1.455361     | 1.446129     |
|                            |                             | <b>Difference (%)</b>        | <b>-46</b>   | <b>-48.2</b> | <b>-50.2</b> | <b>-51.4</b> | <b>-52.3</b> | <b>-53.3</b> | <b>-53.1</b> |
|                            | Horizontal                  | Without soil ionization [pu] | 2.710763     | 2.683562     | 2.670179     | 2.662341     | 2.657103     | 2.658418     | 2.654417     |
|                            |                             | With soil ionization [pu]    | 1.650597     | 1.565274     | 1.515045     | 1.475910     | 1.458944     | 1.448245     | 1.441550     |
|                            |                             | <b>Difference (%)</b>        | <b>-39.1</b> | <b>-41.7</b> | <b>-43.3</b> | <b>-44.6</b> | <b>-45.1</b> | <b>-45.5</b> | <b>-45.7</b> |

**Table 4** Number of rods versus maximum voltage

| Number of rods | Maximum Voltage [pu] |
|----------------|----------------------|
| 0              | 1.432315             |
| 4              | 1.431538             |
| 8              | 1.431418             |
| 20             | 1.430909             |
| 40             | 1.429505             |

**Table 5** Length of rods versus maximum voltage




| Length of rods [m] | Maximum Voltage [pu] |
|--------------------|----------------------|
| 2                  | 1.431769             |
| 4                  | 1.431538             |
| 6                  | 1.431382             |
| 8                  | 1.431241             |
| 10                 | 1.431119             |

### 4.3.2 Influence of impulse injection point on maximum voltage

Impulse injection point to grounding system at tower footing is very important to calculate initiation voltage of BF. In general, the injection position has been categorized to three types as shown Table 6.

The results have been presented in Table 7 for the mentioned types of injection point. As shown, for the same grounding system, the maximum voltage on a tower for injection point at the center is smaller than that for injection point at the corner. In the case of injection point at the corner, the inductance of conductors will be considerable and will prevent the current passing through the grounding system towards other directions. But the case of injection point at the center makes the grounding system to show small inductive effect. Therefore, using Type 2 is recommended instead of Type 1. Also the obtained results show that the induced maximum voltage on a tower has the lowest value for Type 3, which is the best type of injection point.

**Table 6** Connection form of tower foots to grounding system


|        |   |
|--------|---|
| Type 1 |   |
| Type 2 |  |
| Type 3 |  |

**Table 7** Connection point versus maximum voltage

| Case study | Maximum voltage [pu] |
|------------|----------------------|
| Type 1     | 1.448437             |
| Type 2     | 1.437178             |
| Type 3     | 1.431538             |

### 4.4 Grounding system design in rocky surfaces by using TLM

In general, some limitations such as rocky areas where the towers are spotted, limitation of required area for grounding installation, dry soil and other geological factors may make undesirable and unsafe installed grounding system. Two-story grounding system design is one of the proposed methods to obtain a safe voltage as shown in Fig 9.

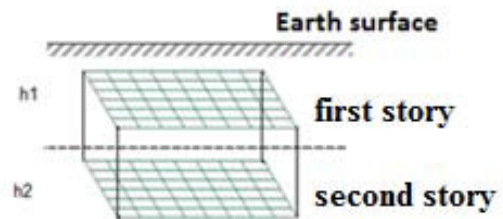

**Fig 9** Two-story grounding system.

Table 8 shows the maximum voltage across insulator chain for a conventional horizontal grounding system and two-story grounding system with  $h_1=0.4\text{m}$ ,  $h_2=0.8\text{m}$  and four vertical rods with having length of  $0.4\text{m}$ .

**Table 8** Comparison between two types of grounding systems ( $20 \times 20\text{m}^2$ )

| Grounding system type                      | Maximum voltage [pu] |
|--|----------------------|
| A conventional horizontal grounding system | 1.516496             |
| Two-story grounding system                 | 1.468332             |

Table 9 depicts the equivalent two depth grounding network which can be substituted by a conventional grounding system with larger dimensions. Therefore this design is suitable for rocky areas, dry soil and etc.

**Table 9** Comparison between extended grounding systems

| Grounding system Type                      | Maximum voltage [pu] | Dimensions [m×m] |
|--|----------------------|------------------|
| A conventional horizontal grounding system | 1.513878             | $20 \times 20$   |
| Two-story grounding system                 | 1.523755             | $8 \times 10$    |

## 5. Conclusion

Using a proper grounding system and an accurate transient modeling of tower footing grounding grid have significant effect on the maximum induced voltage caused by lightning stroke across the insulator chains. The obtained results showed that the soil ionization phenomenon has considerably contribution on the inception of BF occurrence. Moreover, current injection point to tower footing grounding system shows that the

choosing Type 3 for connection is a better scenario rather than lowering the probability of the BF initiation.

Furthermore, applying two-story design for grounding system (suitable for rocky areas) has shown lower over voltages.

### References

- [1] Ali F. Imece and et al, "Modeling Guidelines for Fast Front Transient", *IEEE Transaction on Power Delivery*. Vol. 11, No. 1, pp 493–506, 1996.
- [2] IEEE Working Group. "IEEE guide for improving the lightning performance of transmission lines." (1997).
- [3] B. Marungsri, S. Boonpoke, A. Rawangpai, A. Oonsivilai, and C. Kritayakornpong, "Study of Tower Grounding Resistance Effected Back Flashover to 500 kV Transmission Line in Thailand by Using ATP/EMTP", *World Academy of Science, Engineering and Technology*, Vol. 2, pp. 73-80, 2008.
- [4] L. Qi, H. Yuan, Y. Wu, X. Cui, "Calculation of Overvoltage on Nearby Underground Metal Pipeline Due to the Lightning Strike on UHV AC Transmission Line Tower", *Electric Power Systems Research*, Vol. 94, pp. 54-63, 2013.
- [5] Z. Zhao, Dong Dang, Guangning Wu, Xiaobin Cao, Jun Zhu, Li Chen, Jinsong Hu, "Simulation Study on Transient Performance of Lightning Overvoltage of Transmission Lines", *7th Asia-Pacific International Conference on Lightning*, pp. 520-524, 2011.
- [6] L. Zhiwei, L. Dachuan, "The Lightning Protection Performance of Back Striking for Double-circuit Transmission Line Based on the Distributed Transmission Line Tower Model", *7th Asia-Pacific International Conference on Lightning*, China, Nov. 2011.
- [7] F.M. Gatta, A. Geri, S. Lauria, M. Maccioni, "Equivalent Lumped Parameter Network of Typical Tower Grounding Systems for Linear and Non-linear Transient Analyses", *IEEE Bucharest Power Tech Conference*, pp. 1-6, 2009.
- [8] F.M. Gatta, A. Geri, S. Lauria, M. Maccioni, "Equivalent Lumped Parameter Pi-network of Standard Grounding Systems under Surge Conditions", *Proceedings of 30th International Conference on Lightning Protection*, pp 1090, 2010.
- [9] F.M. Gatta, A. Geri, S. Lauria, M. Maccioni, "Simplified HV Tower Grounding System Model

for Back Flashover Simulation", *Electric Power Systems Research*, Vol. 85, pp. 16– 23, 2012.

- [10] Z. Yuan, H. Li, L. Xiang, "Influence of Different Tower Models on the Lightning Back-strike Intruding Wave Overvoltage for UHV Substation", *High Voltage Engineering*, Vol. 34, pp. 867–872, 2008.
- [11] T. Hara, O. Yamamoto, M. Hayashi, "Empirical Formula of Surge Impedance for Single and Multiple Vertical Cylinder", *IEEJ Transactions on Power and Energy*, Vol. 110, No. 2, pp. 129–136, Dec. 1990.
- [12] L. Grcev, "Modeling of Grounding Electrodes under Lightning Current", *IEEE Transaction on Electromagnetic Compatibility*, Vol. 51, No. 3, 2009.
- [13] Gazzana, Bretas, Guilherme A. D, "The Transmission Line Modeling Method to Represent the Soil Ionization Phenomenon in Grounding Systems", *IEEE Transactions on Magnetics*, Vol. 50, No. 2, pp. 505-508, 2014.
- [14] G. Celli, E. Ghiani, F. Pilo, "Behavior of Grounding Systems: A Quasi-static EMTP Model and Its Validation", *Electric Power Systems Research*, Vol. 85, pp. 24–29, 2012.



**Faezeh Amanifard** was born in Bojnord, Iran, in 1987. She received the B.Sc. degree from the Shahrood University of Technology, Shahrood, Iran, in 2010 and the M.Sc. degree from University of Science and Technology of Mazandaran, Behshahr, Iran, in 2014, both in power electrical engineering. Her areas of interest include power system analysis, transmission lines, high frequencies analysis and power system protection.



**Nabiollah Ramezani** was born in 1972. He received the B.Sc. degree from KNT University and also M.Sc. and Ph.D. degrees from the Iran University of Science & Technology (IUST), Tehran, Iran in 1997, 1999 and 2009 respectively. He is Assistant Professor at University of Science & Technology of Mazandaran (USTM), Behshahr, Iran. His research interests include power systems protection, transients and distribution system.